


FIELD NOTES

Six-story mixed-use — building riser

Harlow Street Tower

Field survey
Aug 20, 2026

NOT FOR
CONSTRUCTION

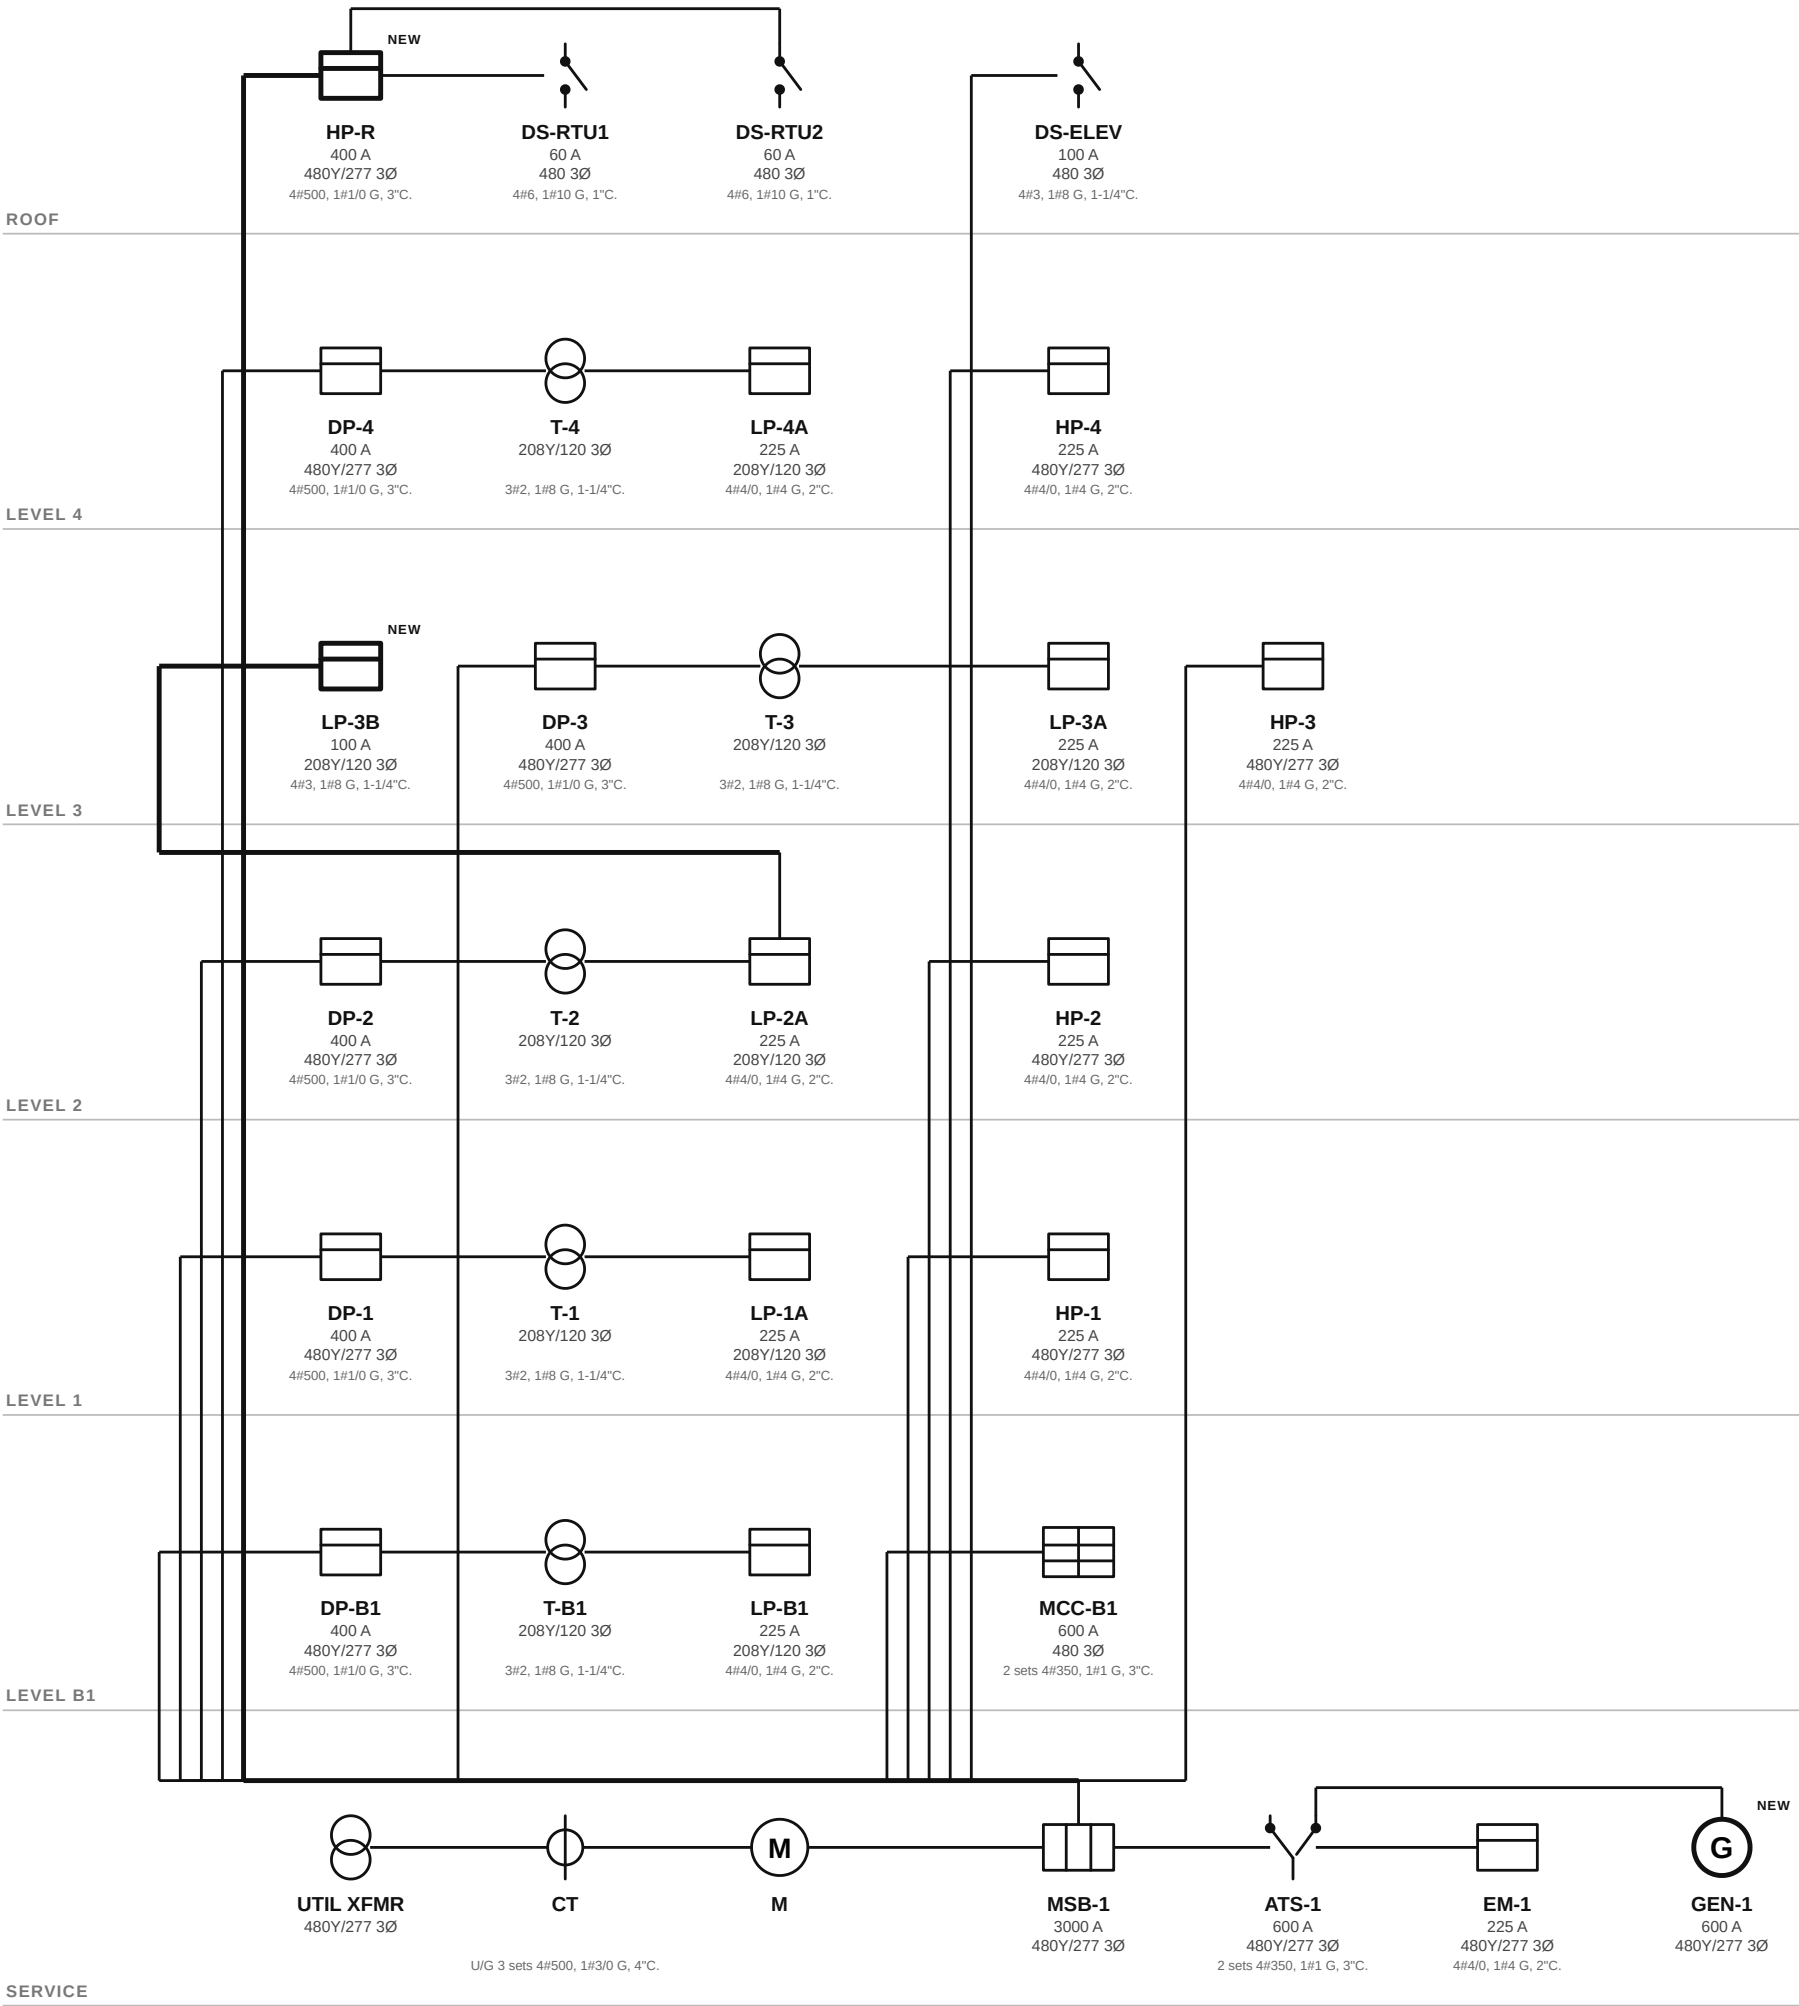

Existing New Demo n = photos attached

NOTES

Riser conductors verified at each floor pull box. ATS-1 fed normal from MSB-1 and standby from GEN-1. Level 3 lighting panel LP-3B is fed from LP-2A one floor down rather than from the switchboard.

Generated by Ampsheet from user-entered values for field reference, coordination and RFI communication only. This is not an engineering document, is not sealed by a licensed professional engineer, and is not a permit or construction submittal. Values are computed from the data entered and have not been verified against actual site conditions. Verify all results against the code edition adopted in your jurisdiction, local amendments, and equipment nameplate data before use.