

FIELD NOTES


Service survey — Building A

Sample Project — 123 Example Ave

A. Estimator

Aug 19, 2026

NOT FOR
CONSTRUCTION

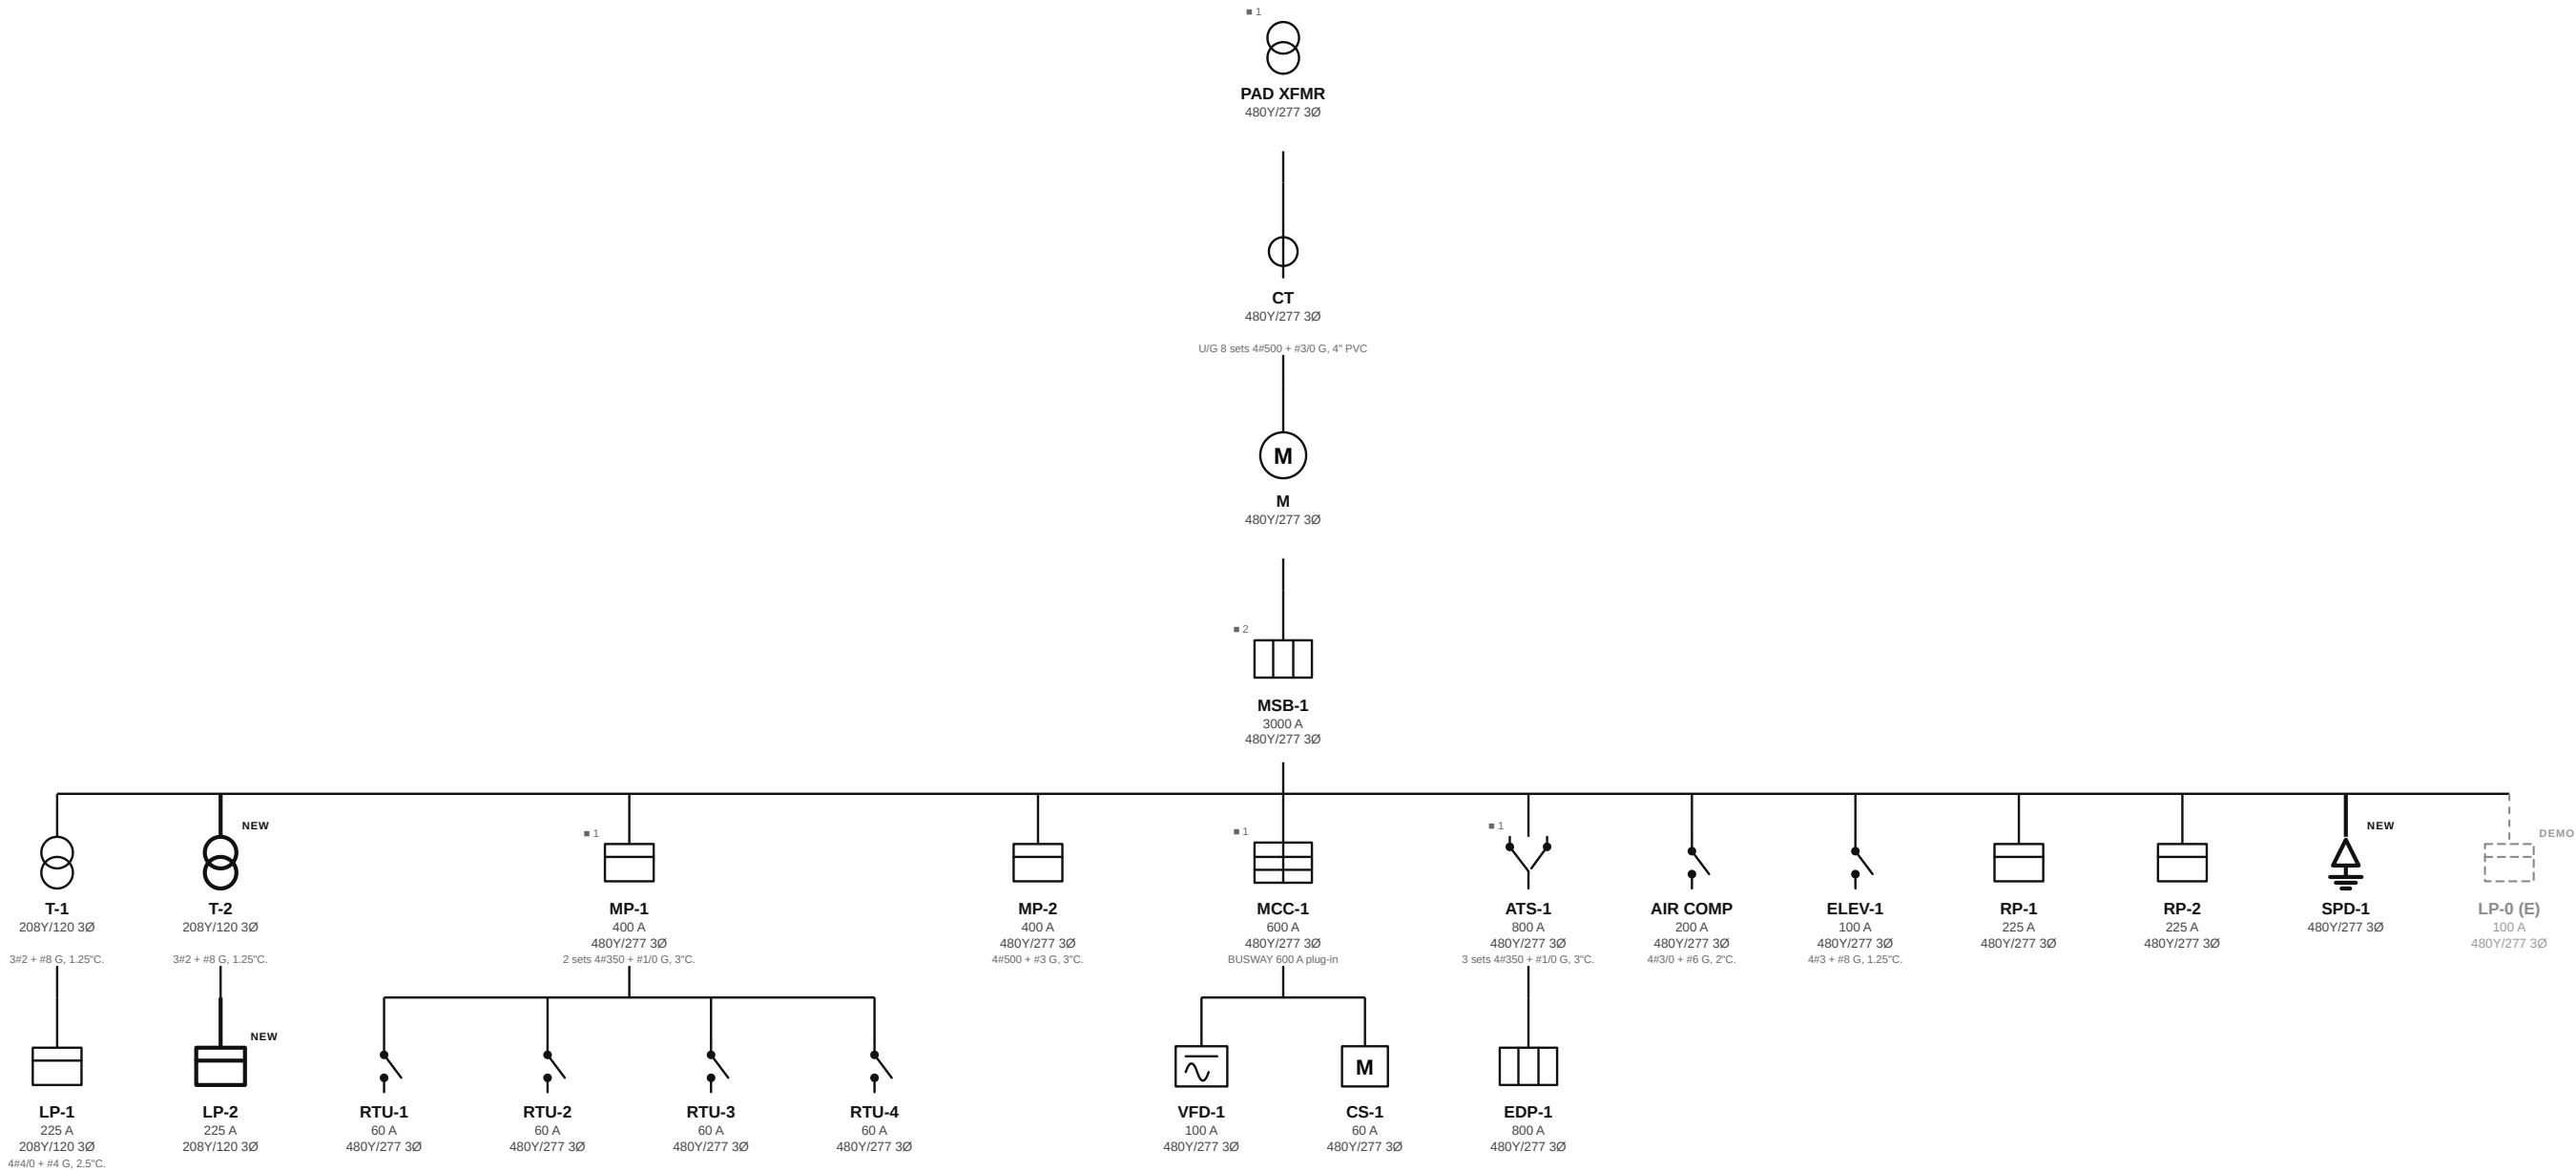

Existing New Demo n = photos attached

NOTES
MSB-1 has 42 in clear working space. T-2, LP-2 and SPD-1 are new under this scope; LP-0 to be demolished. ATS-1 serves the emergency leg — generator is remote and was not surveyed.

- REVIEW
- WARNING** T-1 and T-2 secondaries are 208Y/120; verify the panels they feed are rated for it.
- NOTE** MCC-1 is fed by 600 A busway plug-in — confirm the plug-in matches the bucket schedule.
- NOTE** SPD-1 is new at MSB-1; confirm it lands on a dedicated breaker, not a lug tap.

Generated by Ampsheet from user-entered values for field reference, coordination and RFI communication only. This is not an engineering document, is not sealed by a licensed professional engineer, and is not a permit or construction submittal. Values are computed from the data entered and have not been verified against actual site conditions. Verify all results against the code edition adopted in your jurisdiction, local amendments, and equipment nameplate data before use.